

An ISO 9001: 2008 Company

STATIC EARTH LEAKAGE RELAY













An ISO 9001: 2008 Company

STATIC EARTH LEAKAGE RELAY (ELR) WITH CORE BALANCE CURRENT TRANSFORMER(CBCT / ZCT) \rightarrow EL SERIES IEEE Device Code-64





Features

- •Consistent reliability with accuracy.
- •Fixed or variable current sensitivity by Dip Switch selection
- •LED's for visual indication of fault.
- •High Barrier connector at rear for easy termination and safety standards.
- •Tamper proof polycarbonate cover in the front.
- •Test & Reset Facility for testing healthiness of the relay

Applications

- •Frame Leakage protection for L.T. Control Panels and switch boards.
- •Earth Leakage protection for Feeders / Motors / Generators / Transformers / Mobile Operating Equipments.
- •Protection for hazardous sensitive environments like Oil Refineries/ Cement Plant/Steel Plant /Chemical Platforms/Pulp industries and General Electrical Distribution.
- •Protection for Mining & Control Engineering

Specifications

Input auxiliary voltage

: 110V, 230V, 415V, 550V AC 50Hz 48V, 110V, & 220V

Current Sensitivity range

: Variable: 30-300mA,50-2000mA, 300-3000mA 1-4 Amps, 1-8 Amps, 1-10 A, 4-12A.

Fixed: 30mA, 100mA, 300mA, 500mA, also user

specified ranges(sensitivity)









An ISO 9001: 2008 Company

STATIC EARTH LEAKAGE RELAY (ELR) WITH CORE BALANCE CURRENT TRANSFORMER(CBCT / ZCT)→ EL SERIES IEEE DEVICE CODE-64

Tripping time

Variable: 0.15 – 3 sec

Fixed: 100 millisec, 500 millisec, 1 sec & 3 sec

Core balance current transformer type: Tape wound or Resin cast

CBCT / ZCT-Standard size I.D. Circular: 40mm, 65mm, 100mm, 150mm, 200mm,

250mm, 300mm

Rectangular: User specified

Relay contacts : One pair of potential free NO & NC contacts or Two

change over potential free NO & NC Contacts

Contact Rating : 8 Amps/ 250V AC/ 8 Amps, 30 V DC

Mounting Type : Flush / Din

Dimensions in mm

Flush: 96mm x 96mmx70mm

Panel Cutout size: 90x90+0.1 mm

Din: 75x95x75 mm (LxHxD) (fixing on 35mm din channel)

Note: 30-300 mA, 50-2000mA & 30-3000 mA, ELR is available upto 150 mm I.D. CBCT /

ZCT only

Introduction

Earth Leakage Current give rise to generation of heat and result in progressive failure of insulation, which leads to earth faults sparking flashovers, deterioration of earthing and finally results into catastrophic fires which destroys costly equipments, gadgets and precious lives. It is therefore essential to detect earth leakage current well before they cross the threshold limits and isolate the circuit in the event of leakages. Conventional over current and short circuit protection device are not designed detect earth leakage currents.

Prok dv's make Static Earth Leakage Relay (ELR) with Core Balance Current Transformer (CBCT / ZCT) are used to detect the leakage current in an Electrical Power System. Static Earth Leakage Relay (ELR) Transmits a signal to activate the trip coil of the MCCB/ACB/OCB CONTACTOR in the event of Earth leakage, resulting in automatic isolation of the electrical power system. Static earth leakage relay (ELR) and core balance current transformer (CBCT / ZCT) have been widely used and accepted because these have field adaptability and are economic.







An ISO 9001: 2008 Company

STATIC EARTH LEAKAGE RELAY (ELR) WITH CORE BALANCE CURRENT TRANSFORMER(CBCT / ZCT) \rightarrow EL SERIES IEEE Device Code-64

Principle of Operation

Static Earth Leakage Relay(ELR) employs a Core Balance Current Transformer (CBCT / ZCT) to sense the leakage current. The CBCT / ZCT mounted externally and load current carrying cable is passed through the CBCT / ZCT. Ideally in a leakage free system the incoming and outgoing currents are equal and opposite in direction, which means that the vector sum of three phase currents is zero and can be expressed as:

$$\Rightarrow \Rightarrow \Rightarrow$$

Ir + Iy + Ib = 0 for 3 phase 3 wire system.

lr + ly + lb + ln = 0 for 3 phase, 4 wire system.


For the above condition the CBCT / ZCT produces zero resultant magnetic flux keeping the system healthy.

In case of the Earth Leakage due to insulation failure of direct line to ground fault, the vector sum of currents is not zero and therefore generates resultant magnetic flux in the CBCT / ZCT, and signal is fed to the electronic circuit of Earth Leakage Relay (ELR). This signal is compared with internal reference determined by the selected position of the leakage current scale in the front facia of the relay. This energizes the output when the signal crosses the preset level. The potential free contacts of the relay is connected to the Shunt Trip/ No volt coil of the main trip device like MCCB/OCB/ACB/CONTACTOR etc., Under fault condition the output relay gets activated by cutting off or tripping against Earth Leakage /Faults. It is worthwhile to emphasize that the unequal/ unbalanced loading on the phases does not effect the vector sum and as such there is no difficulty in the use of Earth Leakage Relay (ELR) with Core Balance Current Transformer (CBCT / ZCT) on electrical distribution systems with unbalanced loading.

WIRING DIAGRAM FOR FLUSH MOUNTING

STATIC EARTH LEAKAGE RELAY (ELR) WITH CORE BALANCE CURRENT

TRANSFORMER (CBCT / ZCT)

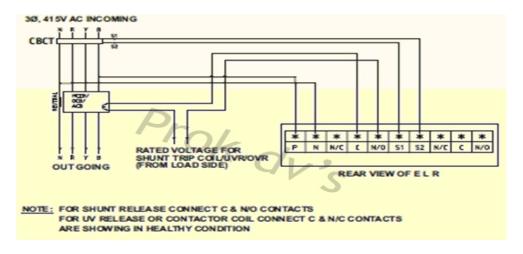









An ISO 9001: 2008 Company

STATIC EARTH LEAKAGE RELAY (ELR) WITH CORE BALANCE CURRENT TRANSFORMER(CBCT / ZCT)→ EL SERIES IEEE DEVICE CODE-64

STATIC EARTH LEAKAGE RELAY (ELR)
HIERARCHY-(Time & Current sensitivity)

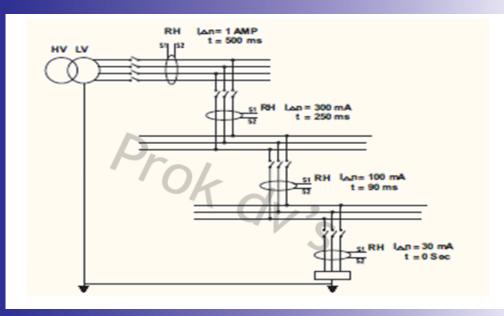

WIRING DIAGRAM FOR DIN MOUNTING STATIC EARTH LEAKAGE RELAY (ELR) WITH CORE BALANCE CURRENT TRANSFORMER (CBCT / ZCT)

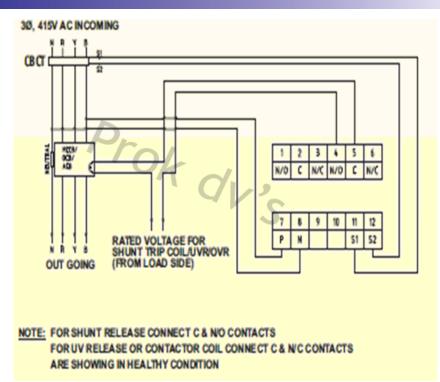









An ISO 9001: 2008 Company

STATIC EARTH LEAKAGE RELAY (ELR) WITH CORE BALANCE CURRENT TRANSFORMER(CBCT / ZCT)→ EL SERIES IEEE DEVICE Code-64

RESIN CAST CORE BALANCE CURRENT TRANSFORMER (CBCT / ZCT) DIMENSIONS

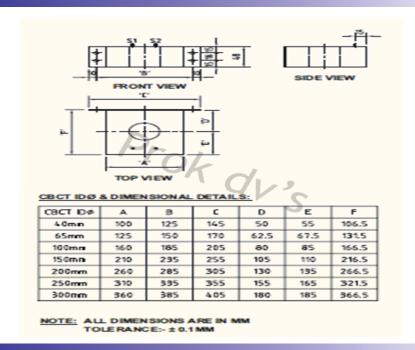

MECHANICAL DIMENSION OF DIN MOUNTING STATIC EARTH LEAKAGE RELAY (ELR)

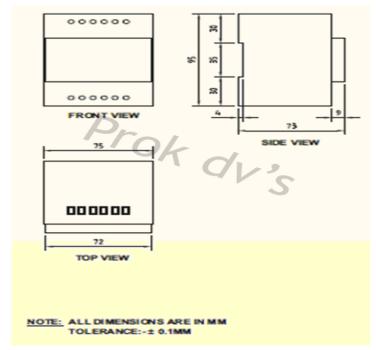








An ISO 9001: 2008 Company

STATIC EARTH LEAKAGE RELAY (ELR) WITH CORE BALANCE CURRENT TRANSFORMER(CBCT / ZCT)→ EL SERIES IEEE Device Code-64

MECHANICAL DIMENSION OF FLUSH MOUNTING STATIC EARTH LEAKAGE RELAY (ELR)

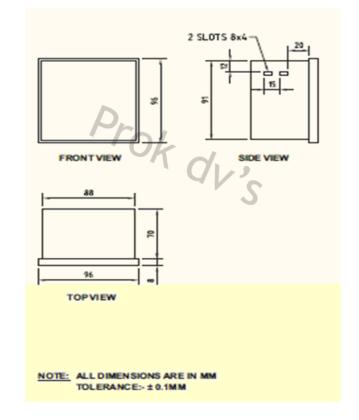





An ISO 9001: 2008 Company

STATIC EARTH LEAKAGE RELAY (ELR) WITH CORE BALANCE CURRENT TRANSFORMER(CBCT / ZCT)→ EL SERIES IEEE DEVICE CODE-64



Prok Devices Private Limited
SIMHADRI,
No.2930, 14 th Cross,
Banashankari II nd Stage,
Off K.R. Road,
Bengaluru-560070
Karnataka
India

Tel:+91 80 43487777/26760718/26761719

Fax: +91 80 26761720

Email: info@prokdvs.com





